



KIT PUNTO DI TRAVASO A DISTANZA REMOTE FILLING KIT

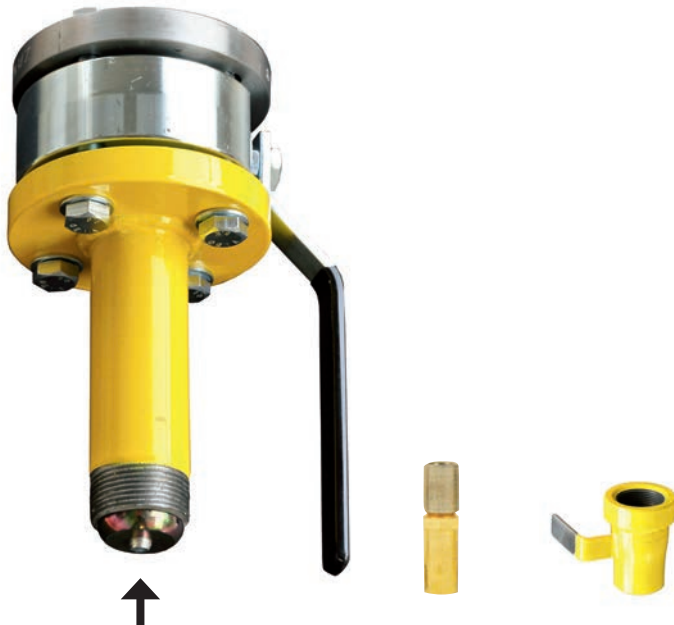

Valvola di non ritorno
Check valve

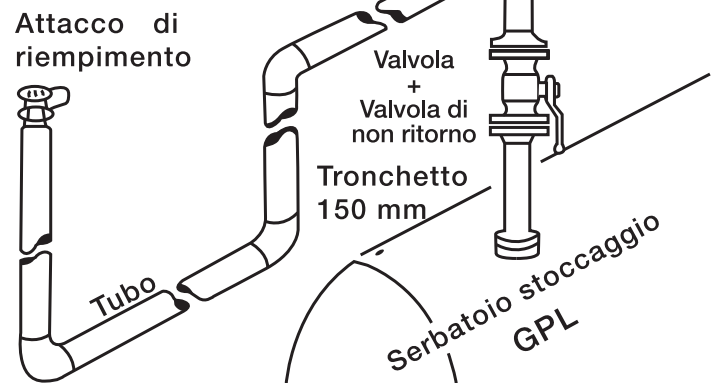

COMPOSIZIONE:

- Tronchetto filettato Ø 1"1/4 da saldare su tubo Ø 1"1/4.
- Piastrina per collegamento pinza messa a terra ATS.
- Viti 12 MA 8.8 passavite.
- Flangia UNI 2284/2229 Ø 1"
- Guarnizione Ø 1" per GPL.
- Valvola a sfera Ø 1" PN 40 a passaggio totale.
- Dado esagonale per viti 12 MA.
- Tronchetto filettato H=150mm da installare sul serbatoio con valvola di non ritorno M1"1/4 NPT x flangia DN 25 PN 40.
- Piastrina collegamento treccia rame.
- Manicotto in acciaio serie 3000.
- Valvola di sicurezza tarata a 18 bar.

COMPOSITION:

- Threaded stub pipe Ø 1"1/4 to be welded on Ø 1"1/4 pipe.
- ATS earthing pliers connection plate.
- Passivated screws 12 MA 8,8.
- Flange UNI 2284/2229 Ø 1"
- LPG seal 1"
- Ball valve Ø 1" PN 40 full bore.
- Hexagonal nut for 12 MA.
- Threaded stub pipe H=150mm to be installed on tank with check valve M1"1/4 NPT x flange DN 25 PN 40.
- Copper pliat connection plate.
- Steel sleeve series 3000.
- Safety valve set to 18 bar.

Cod.	Descrizione - Description
KPT301	KIT PUNTO DI TRAVASO A DISTANZA REMOTE FILLING KIT
KPT 301-C	KIT PUNTO DI TRAVASO A DISTANZA CURVO REMOTE CURVED FILLING KIT

